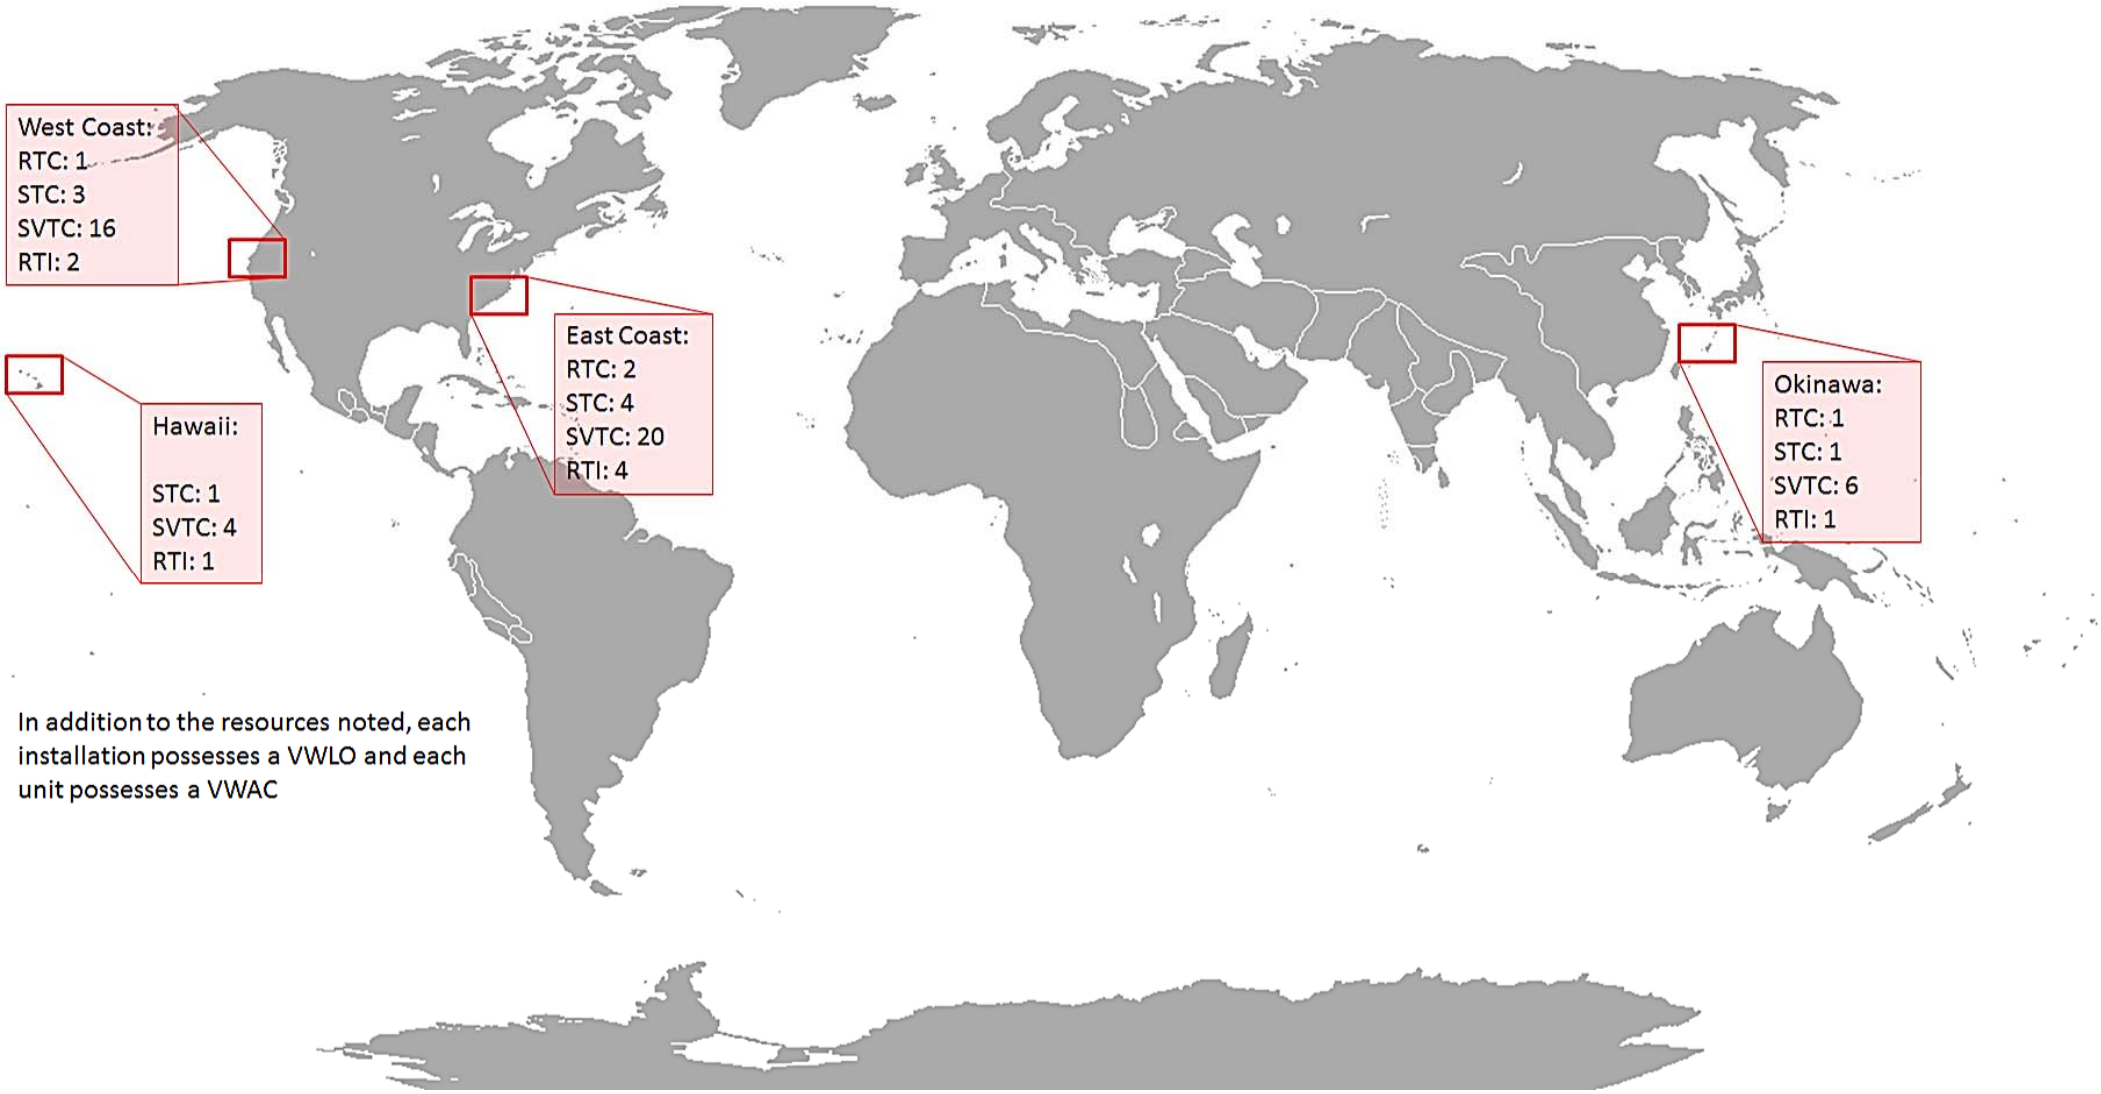

In addition to the resources noted, each installation possesses a VWLO and each unit possesses a VWAC